


# CONNECTIONS TO ASBESTOS CEMENT PIPE (ACP):

1. CONTRACTOR SHALL POTHOLE EXISTING ACP WATER MAIN TO DETERMINE EXACT LOCATION, DIMENSIONS, ELEVATION AND ORIENTATION OF WATER MAIN INCLUDING LOCATIONS OF EXISTING PIPE JOINTS.
2. HOT TAPS OF EXISTING ACP PIPE WILL NOT BE ALLOWED FOR SIZE ON SIZE CONNECTIONS. EXISTING ACP PIPE SHALL BE REMOVED TO NEAREST JOINT. INSTALL NEW TEE, GATE VALVE & THRUST BLOCK.
3. TAPPED CONNECTIONS SHALL NOT BE CLOSER THAN 24" (EDGE TO EDGE) TO AN EXISTING PIPE FITTING OR JOINT.
4. HOT TAP CONNECTION TO EXISTING ACP WATER MAIN SHALL BE COORDINATED WITH VALLECITOS WATER DISTRICT. CONTRACTOR SHALL PROVIDE MINIMUM TWO WEEK NOTICE TO VALLECITOS WATER DISTRICT PRIOR TO THE HOT TAP EVENT.
5. VALLECITOS WATER DISTRICT RESERVES THE RIGHT TO SELECT THE HOURS OF THE DAY AND DAY OF THE WEEK DURING WHICH THE HOT TAP CONNECTION WILL BE MADE.
6. HOT TAP CONNECTIONS FOR FIRE HYDRANTS AND DETECTOR CHECK ASSEMBLIES SHALL INCLUDE 6" TAPPING GATE VALVE, TEE & THRUST BLOCK PER VWD STANDARD DRAWING W-16.
7. ABANDONMENT AND DISPOSAL OF ASBESTOS CEMENT PIPE (ACP) SHALL BE THE SOLE RESPONSIBILITY OF THE DEVELOPER AND/OR CONTRACTOR IN ACCORDANCE WITH ALL APPLICABLE LOCAL, STATE AND FEDERAL REGULATIONS.

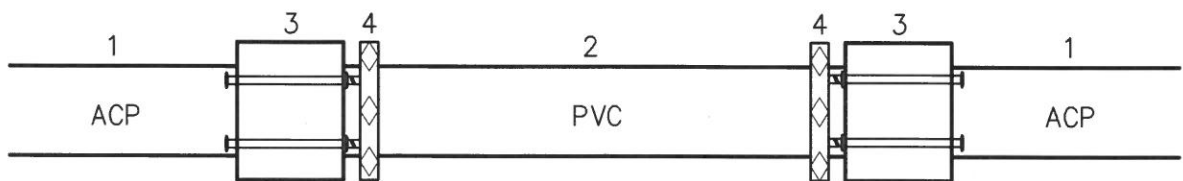

## STANDARD CLOSURE

1. ACP MACHINED END
2. PVC
3. FLEX COUPLING (PER V)
4. MEGA-LUG/UNI-FLANGE