


REMOVE AND REPLACE COATING  
AND LINING AS NECESSARY TO  
INSTALL SERVICE CONNECTION

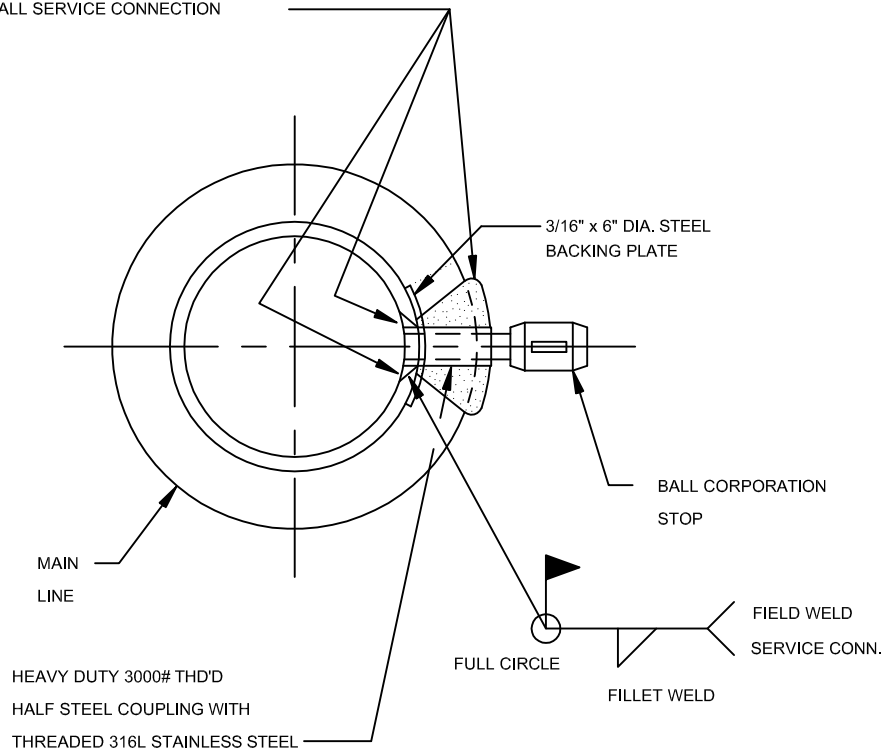

REVISIONS		
DESCRIPTION	APPROVED	DATE
OPERATOR LOCATION		7-24-07
COUPLING AND STEEL PLATE		3-28-17

**VALLECITOS WATER DISTRICT STANDARD DRAWING**

**SERVICE CONNECTION FOR STEEL PIPE**

DATE: JAN. 04

BY:

Drawing No.

**W-26**