

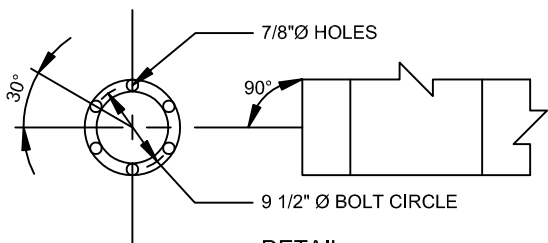


COLOR CODING FOR FIRE FLOWS
WILL BE REQUIRED PER THE DIRECTION
OF LOCAL FIRE JURISDICTION

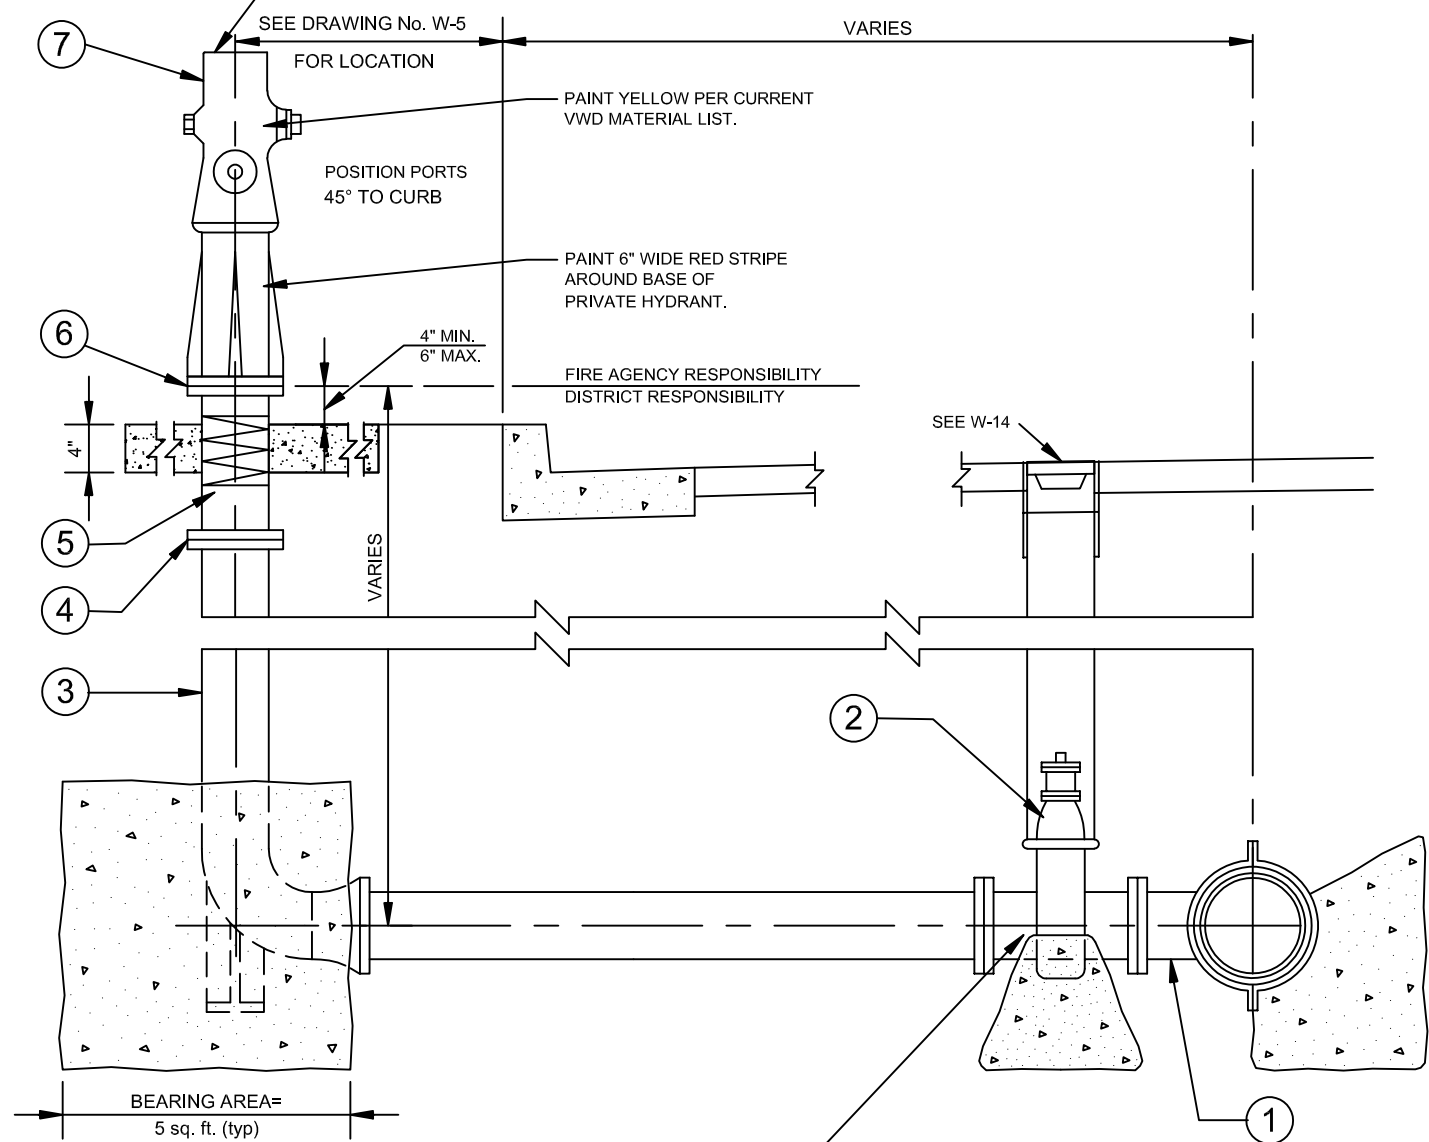

NOTES:

- 1) ALL NUTS & BOLTS BELOW GROUND SHALL BE COATED WITH NO-OXIDE GREASE AND VISQUEEN.
- 2) FL x FL VALVES REQUIRE FL x PO ADAPTER PER MATERIALS LIST.
- 3) WARNING TAPE AND TRACER WIRE SHALL BE INSTALLED PER W-18.



ITEM	MATERIAL	ITEM	MATERIAL
(1)	MAIN SIZE x 6" FLG TEE	(6)	PLATED BREAK-OFF NUTS AND BOLTS W/ RING GASKET
(2)	6" PO x FL VALVE	(7)	FIRE HYDRANT
(3)	6" PO x FL BURY SHORT RADIUS		
(4)	PLATED NUTS AND BOLTS W/ RING GASKET		
(5)	18" MIN. BREAK-OFF SPOOL, DOUBLE SCORE, W/ 2" x 10 MIL TAPE		

REVISIONS		
DESCRIPTION	APPROVED	DATE
REMOVED ADAPTOR & VALVE STEM		9-9-16
ADDED PAINT NOTES		5-9-17
CLARIFIED AGENCY RESPONSIBILITY		11-14-22
ADDED TRACER WIRE NOTE 3		11-29-22

VALLECITOS WATER DISTRICT STANDARD DRAWING

FIRE HYDRANT INSTALLATION

DATE: JAN. 04

BY:

Drawing No.
W-4